


EXPT B-26

AMES TEST  
 =====

CIG SAMPLE NO MARK  
 SMOKE TYPE M  
 RUN NO -1  
 SP DETAILS AR13  
 DATE 13/1/84  
 FILENAME B-26MARKM-1

DOSE UG.	COLONIES / PLATE			MEAN	CYTO. TOX.
	PLATE 1	PLATE 2	PLATE 3		
0	46.7	37.7	33.3	39.2	0
50	90.7	89.7	95	91.8	-
100	148.3	175	187.3	170.2	-
150	251.3	152.3	187.3	197	-
200	276.7	295	234	268.6	-
250	340	366.3	315	340.4	-
300	399.7	333	414	382.2	0

101014748

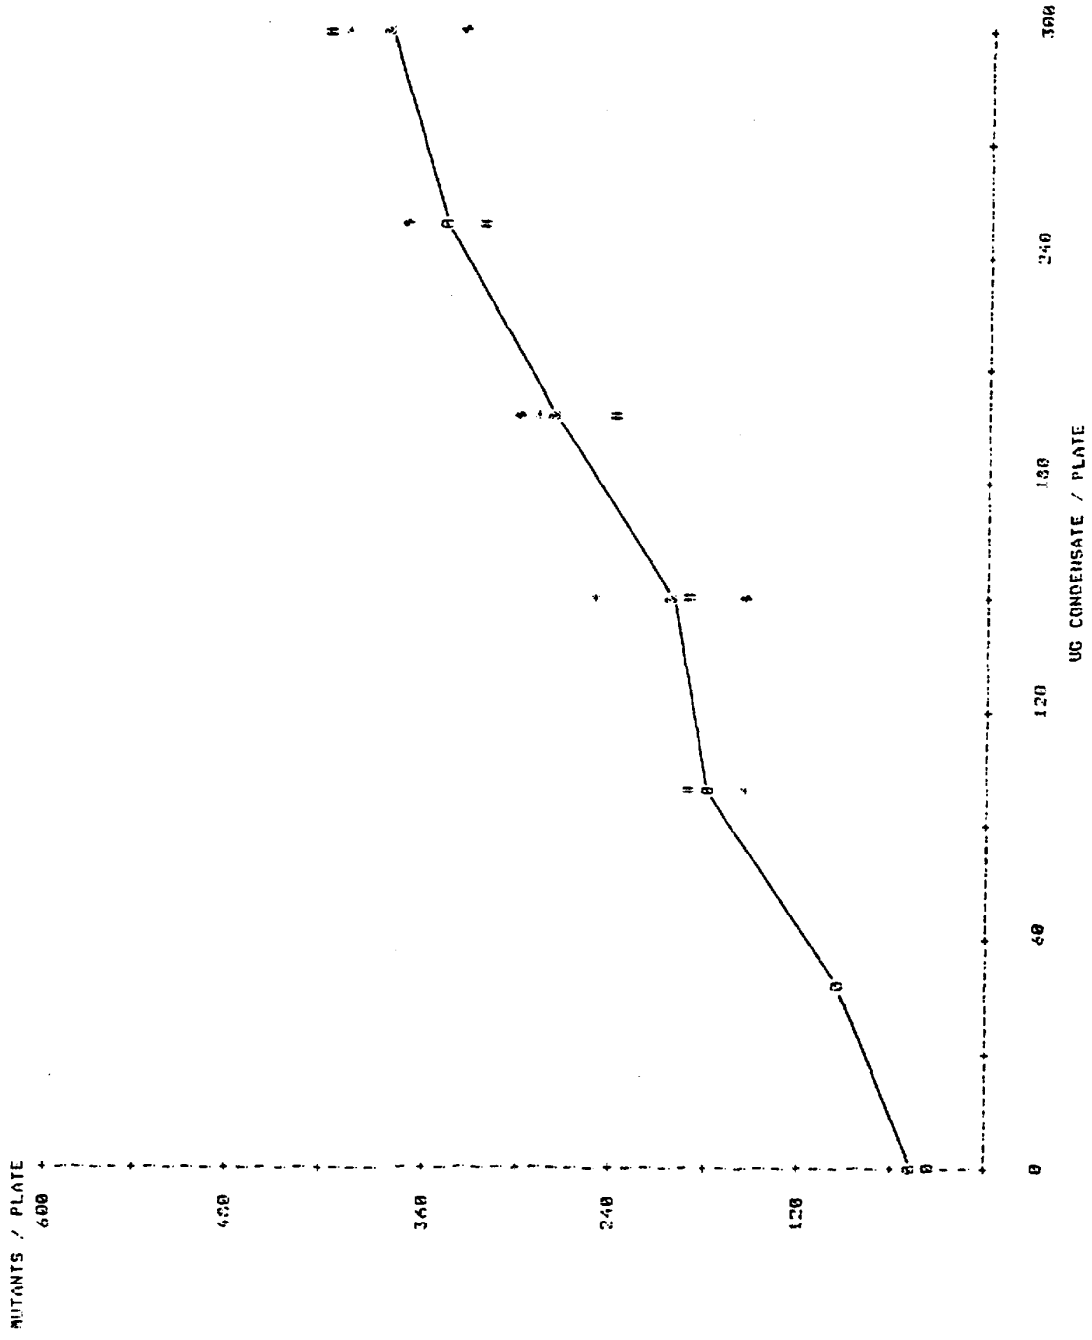

KEY: PLATE1 ← PLATE2 ← PLATE3 ← PLATE4 ← PLATE5 ← PLATE6 ← PLATE7 ← PLATE8 ← PLATE9 ← PLATE10 ← PLATE11 ← PLATE12 ← PLATE13 ← PLATE14 ← PLATE15 ← PLATE16 ← PLATE17 ← PLATE18 ← PLATE19 ← PLATE20 ← PLATE21 ← PLATE22 ← PLATE23 ← PLATE24 ← PLATE25 ← PLATE26 ← PLATE27 ← PLATE28 ← PLATE29 ← PLATE30 ← PLATE31 ← PLATE32 ← PLATE33 ← PLATE34 ← PLATE35 ← PLATE36 ← PLATE37 ← PLATE38 ← PLATE39 ← PLATE40 ← PLATE41 ← PLATE42 ← PLATE43 ← PLATE44 ← PLATE45 ← PLATE46 ← PLATE47 ← PLATE48 ← PLATE49 ← PLATE50 ← PLATE51 ← PLATE52 ← PLATE53 ← PLATE54 ← PLATE55 ← PLATE56 ← PLATE57 ← PLATE58 ← PLATE59 ← PLATE60 ← PLATE61 ← PLATE62 ← PLATE63 ← PLATE64 ← PLATE65 ← PLATE66 ← PLATE67 ← PLATE68 ← PLATE69 ← PLATE70 ← PLATE71 ← PLATE72 ← PLATE73 ← PLATE74 ← PLATE75 ← PLATE76 ← PLATE77 ← PLATE78 ← PLATE79 ← PLATE80 ← PLATE81 ← PLATE82 ← PLATE83 ← PLATE84 ← PLATE85 ← PLATE86 ← PLATE87 ← PLATE88 ← PLATE89 ← PLATE90 ← PLATE91 ← PLATE92 ← PLATE93 ← PLATE94 ← PLATE95 ← PLATE96 ← PLATE97 ← PLATE98 ← PLATE99 ← PLATE100

101014749

BATCo document for Province of British Columbia 16 April 1999