


EXPT B-26

AMES TEST

CIG SAMPLE NO PLAY
 SMOKE TYPE M
 RUN NO -1
 SP DETAILS AR13
 DATE 13/1/84
 FILENAME B-26PLAYM-1

DOSE UG.	COLONIES / PLATE			MEAN	CYTO. TOX.
	PLATE 1	PLATE 2	PLATE 3		
0	45.7	28.7	44.3	39.6	0
50	108.7	150.3	130.3	129.8	-
100	239	248	269	252	-
150	375.7	286.3	380.3	347.4	-
200	430	420	293.7	377.9	-
250	448.3	463.3	494.3	468.6	-
300	460.3	472.7	421.7	451.6	0

101014750

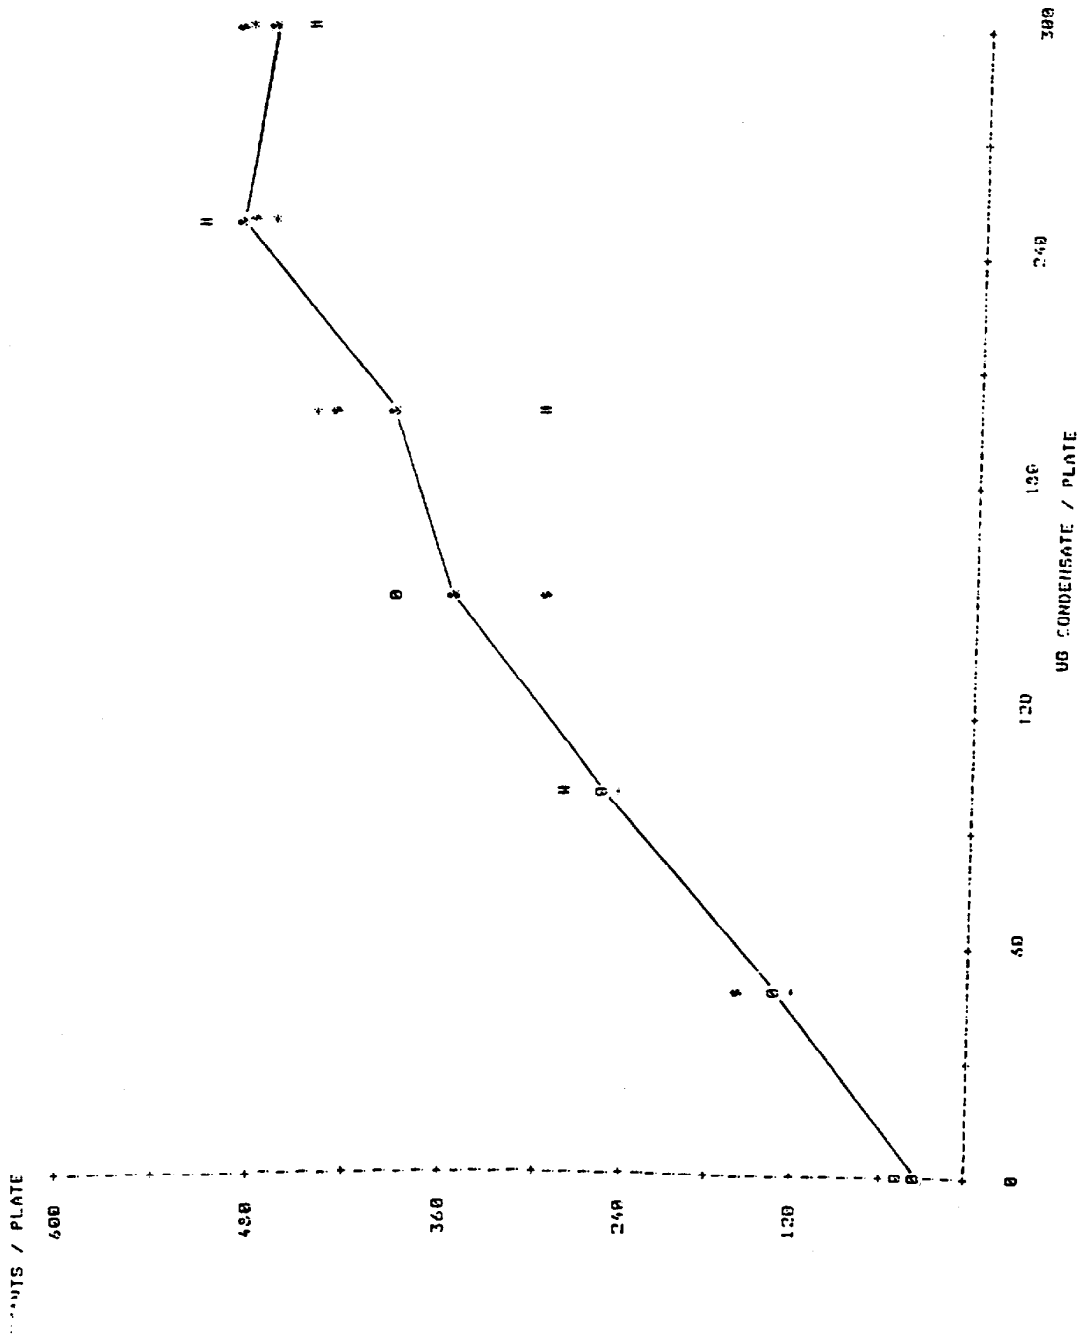

KEY: --PLATE1 \$-PLATE2 H-PLATE3 \$-MEAN UG CONDENSATE / PLATE FTLEMMNF-B-26PLAT0-1

101014751