

BATCO document for Province of British Columbia 16 April 1999


EXPT B-26

AMES TEST  
\*\*\*\*\*

CIG SAMPLE NO CRAW  
SMOKE TYPE M  
RUN NO -1  
S9 DETAILS AR13  
DATE 13/1/84  
FILENAME B-26CRAWM-1

DOSE UG.	COLONIES / PLATE				MEAN	CYTO. TOX.
	PLATE 1	PLATE 2	PLATE 3			
0	43	42.7	41.3	42.3	0	
50	113	115	106.3	111.4	-	
100	168.7	163.7	133	155.1	-	
150	240.7	240.7	223	234.8	-	
200	289	330	276	298.3	-	
250	364.7	395.3	302.7	354.2	-	
300	445	437	389.3	423.8	0	

101014752

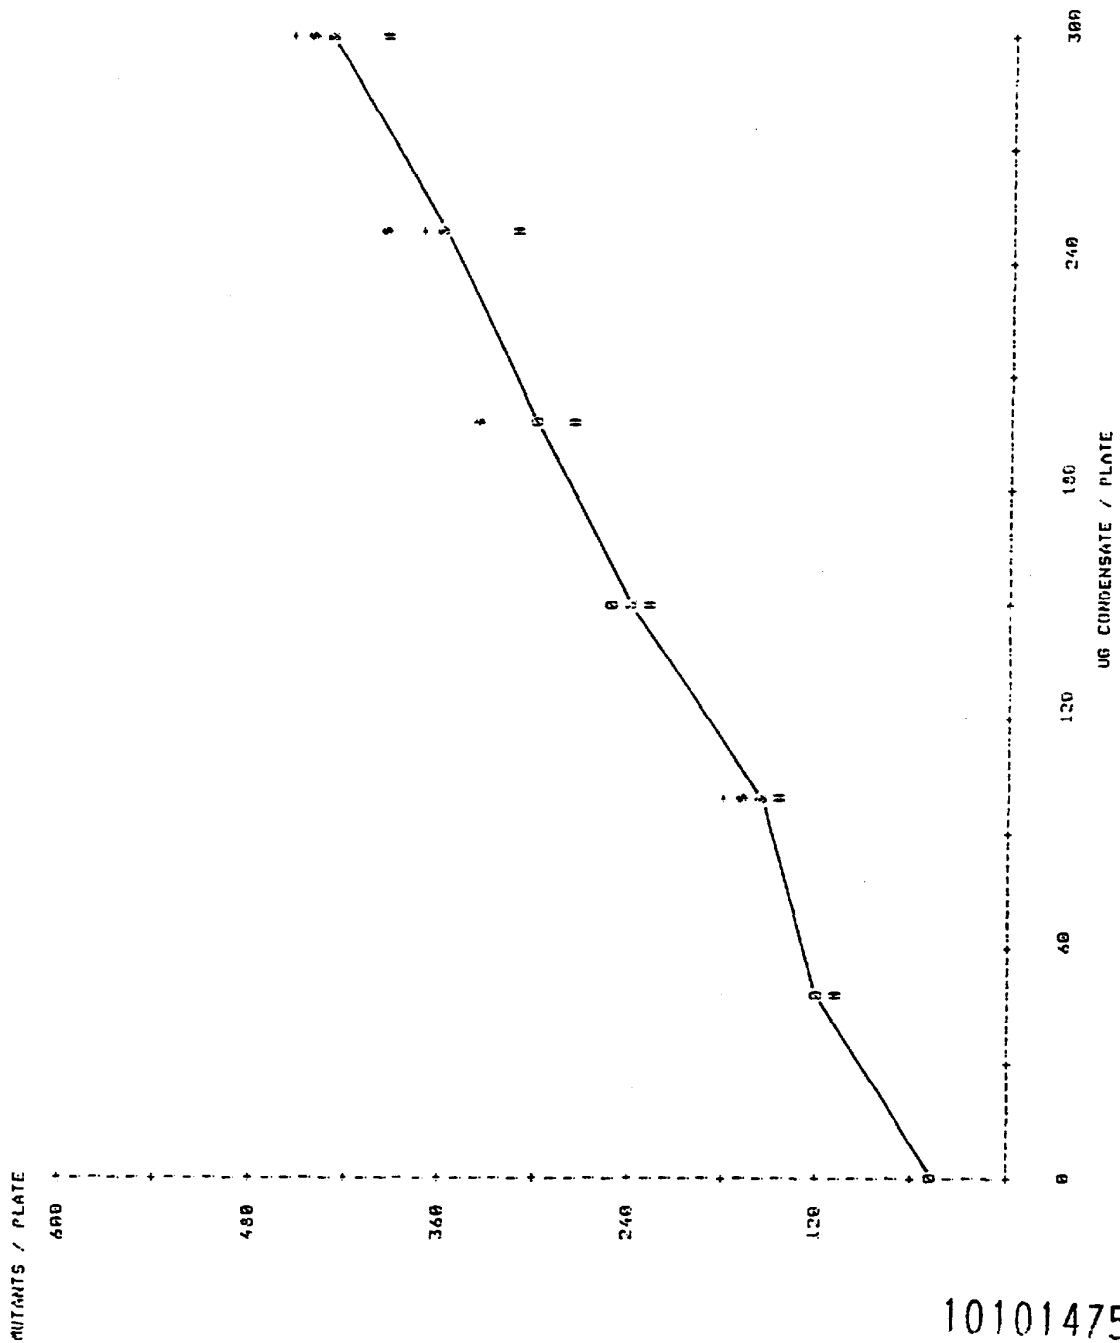

101014753