


BATCO document for Province of British Columbia 16 April 1999

EXPT 8-26

AMES TEST  
\*\*\*\*\*CIG SAMPLE NO MAT1  
SMOKE TYPE M  
RUN NO -1  
SY DETAILS AR13  
DATE 13/1/84  
FILENAME 8-26MAT1M-1

DOSE UG.	COLONIES / PLATE				CYTO. TOX.
	PLATE 1	PLATE 2	PLATE 3	MEAN	
0	40.3	42.3	33.3	38.6	0
50	69.3	46	77.3	64.2	-
100	127.3	100.7	142	123.3	-
150	181	166.3	187.7	179	-
200	224.3	243	218	228.4	-
250	239.7	302	257	266.2	-
300	267	347.7	340	318.2	0

101014756

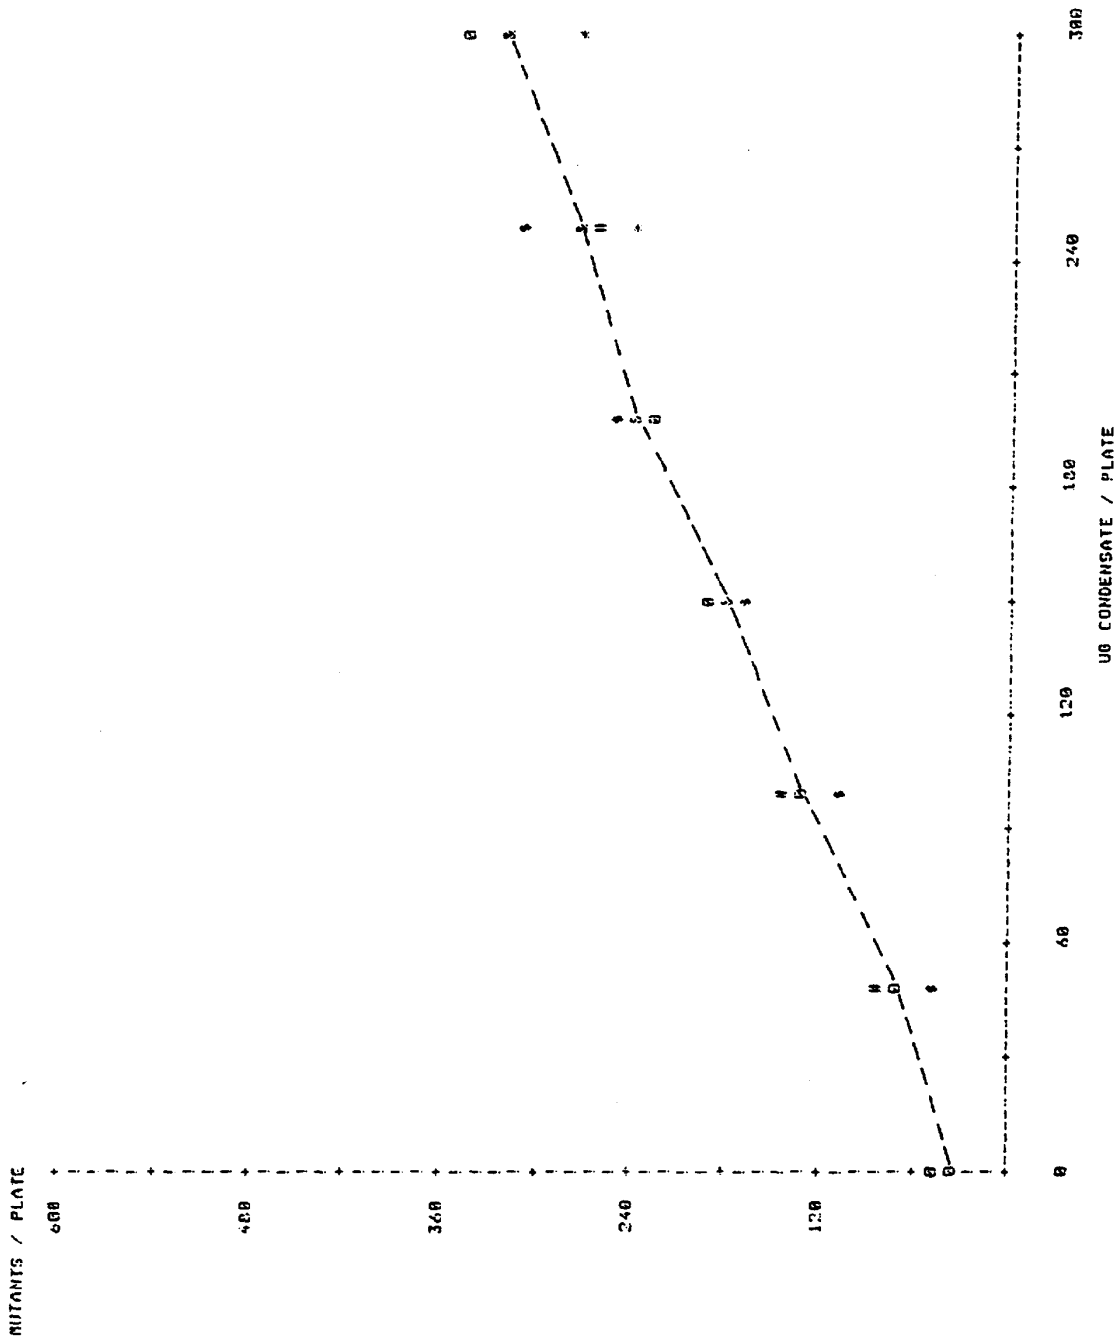

KEY: --PLATE1 \$-PLATES #-PLATES 2--MEAN 3-PLATE1  
 UO CONDENSATE / PLATE FILENAME-B-26MATTM-1

101014757