


EXPT B-26

AMES TEST  
 \*\*\*\*\*

CIG SAMPLE NO PLAY  
 SMOKE TYPE M  
 RUN NO -2  
 SP DETAILS +AR13  
 DATE 16/1/84  
 FILENAME B-26PLAYM-2

DOSE UG.	COLONIES / PLATE			MEAN	CYTO. TOX.
	PLATE 1	PLATE 2	PLATE 3		
0	43.3	51	58	50.8	-
50	68.7	86	71.7	75.5	-
100	106.3	123	114.7	114.7	-
150	177	185.7	165.7	176.1	-
200	328.7	314.7	286.3	309.9	-
250	265.7	234.7	269.3	256.2	-
300	305	233.3	275	271.1	-

101014771

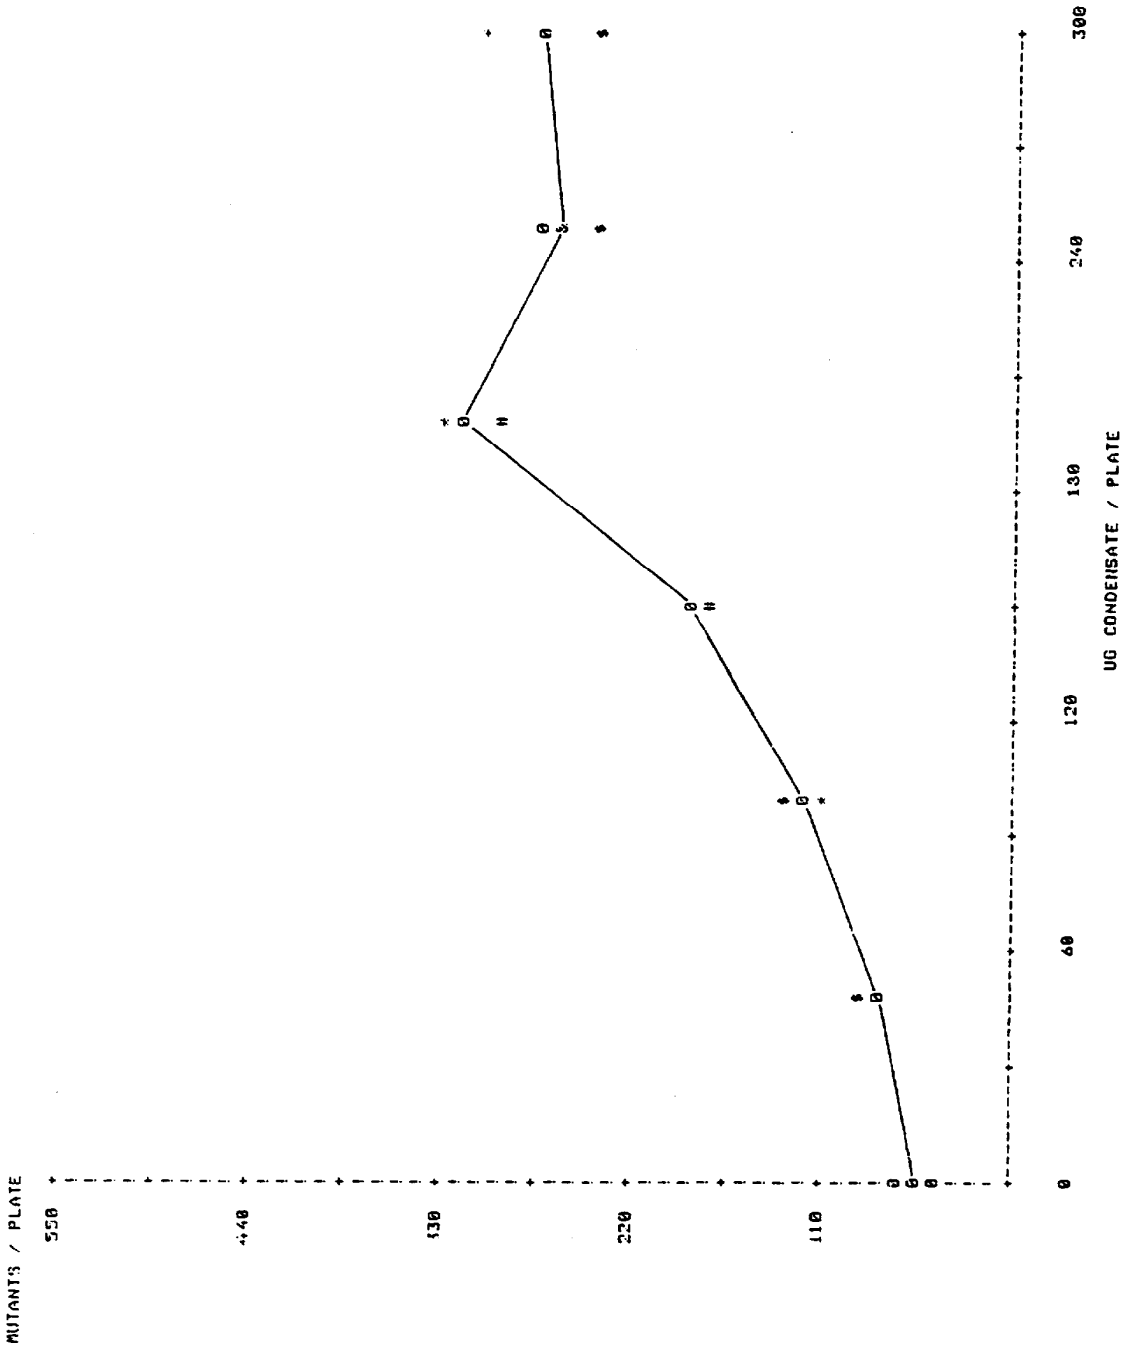

KEY: --PLATE1 \$-PLATE2 H-PLATE3 &-MEAN UG CONDENSATE / PLATE FILENAME-B-26PLAYM-2

101014772