


EXPT B-26

AMES TEST
 =====

CIG SAMPLE NO MARK
 SMOKE TYPE M
 RUN NO -2
 S9 DETAILS +AR13
 DATE 16/1/84
 FILENAME B-26MARKM-2

DOSE UG.	COLONIES / PLATE				MEAN	CYTO. TOX.
	PLATE 1	PLATE 2	PLATE 3			
0	41.7	52	43.7	45.8	-	
50	89.3	88.7	76.3	84.8	-	
100	126.7	159.7	130	138.8	-	
150	138.3	170.7	139.3	166.1	-	
200	209	258.7	244.3	237.3	-	
250	227.3	298.7	251.3	259.1	-	
300	347	337	322	335.3	-	

101014773

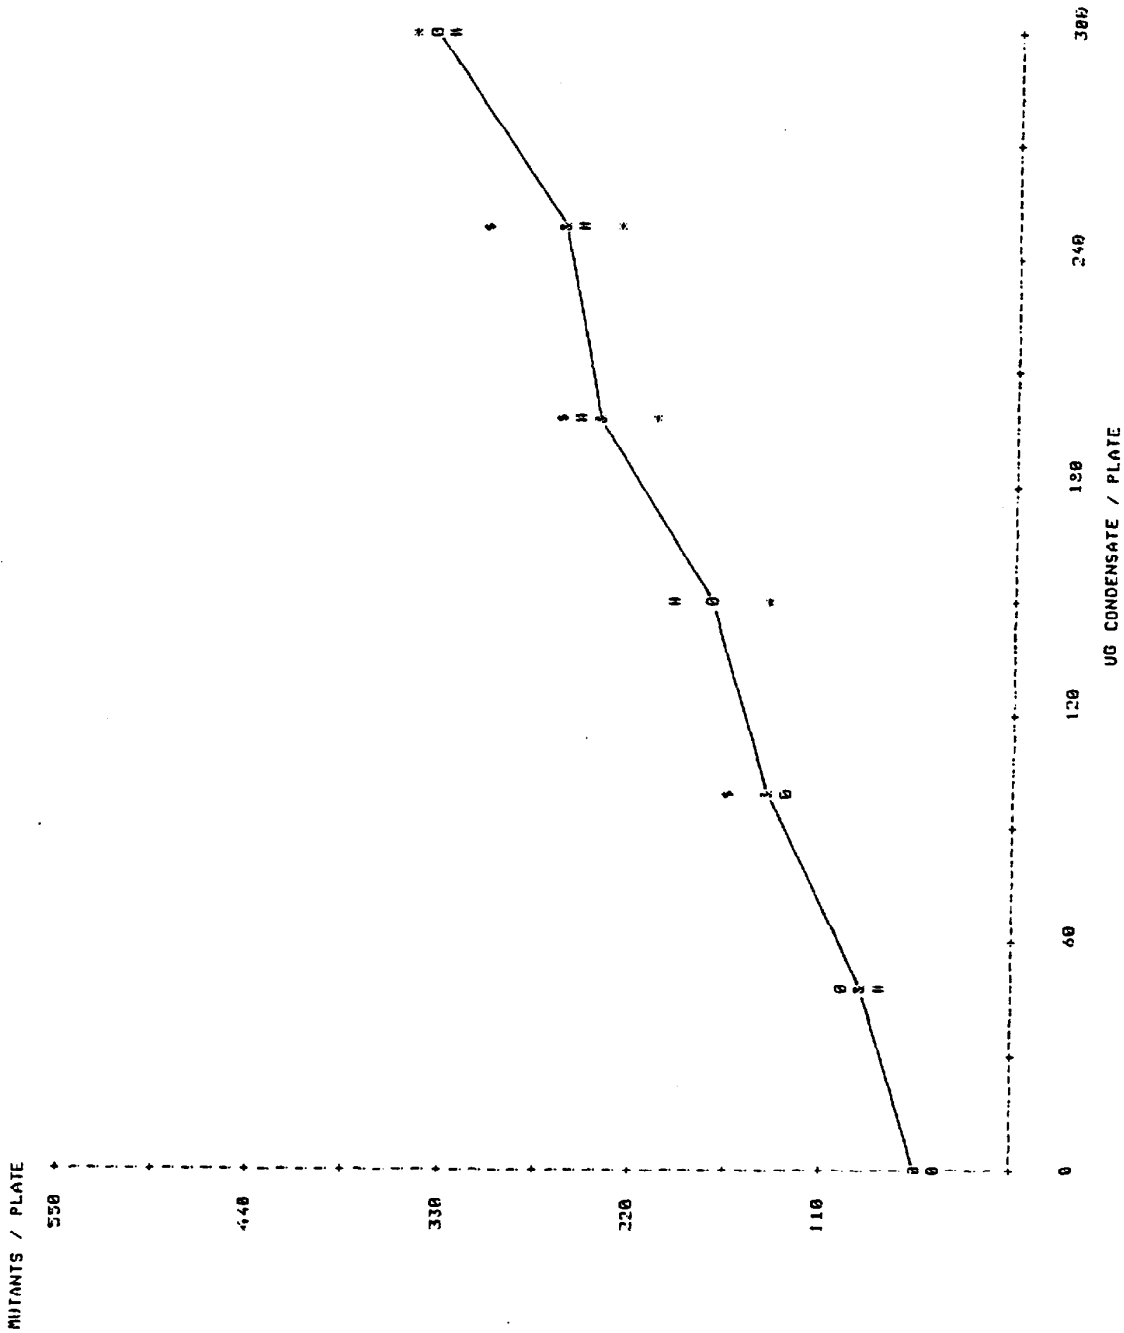

KEY: --PLATE1 \$-PLATE2 B-PLATE3 \$-MEAN FILENAME-B-2SHARKM-1

101014774

BATCo document for Province of British Columbia 16 April 1999