


EXPT 8-26

AMES TEST

CIG SAMPLE NO CRAW
 SMOKE TYPE R
 RUN NO -2
 SP DETAILS +AR13
 DATE 14/1/84
 FILENAME B-26CRAW-2

DOSE UG.	COLONIES / PLATE			MEAN	CYTO. TOX.
	PLATE 1	PLATE 2	PLATE 3		
0	54.3	47	48.7	50	-
50	82.7	93.3	86	87.3	-
100	141.3	159.7	137.3	146.1	-
150	199.7	221	220.7	213.8	-
200	216.3	280.7	248	248.3	-
250	259.3	271.3	310.3	290.3	-
300	420.3	346	344	370.1	-

10101477

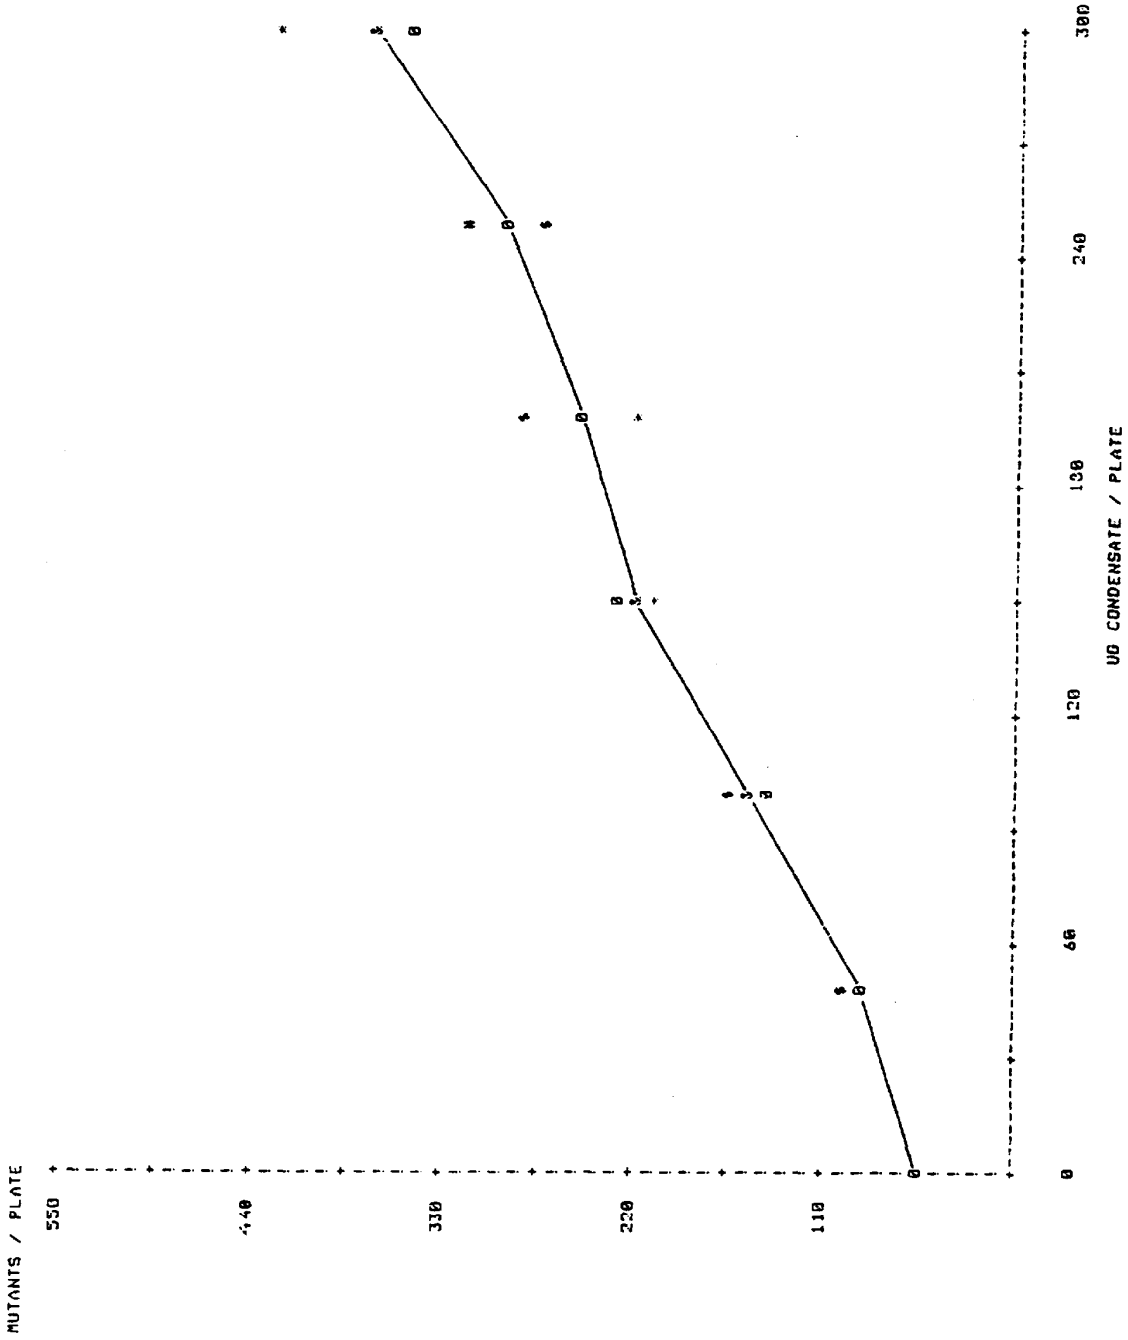

KEY: --PLATE1 \$-PLATE2 N-PLATE3 \$-MEAN FILENAME-B-26DRAWN-2

101014778