


EXPT B-26

AMES TEST

CIG SAMPLE NO MAT1
 SMOKE TYPE M
 RUN NO -3
 SP DETAILS +AR13
 DATE 23/1/84
 FILENAME B-26MAT1M-3

DOSE UG.	COLONIES / PLATE				MEAN	CYTO. TOX.
	PLATE 1	PLATE 2	PLATE 3			
0	36.7	36	42	38.2	98.4	0
50	76.3	68	56.7	67	102.5	-
100	69.3	79	84.7	77.7	118.9	-
150	104	100.7	87.3	97.3	148.9	-
200	152.7	131	121.3	135	206.6	-
250	173.7	176.7	150.7	167	255.5	-
300	170	172	184.7	175.6	268.7	0

101014802

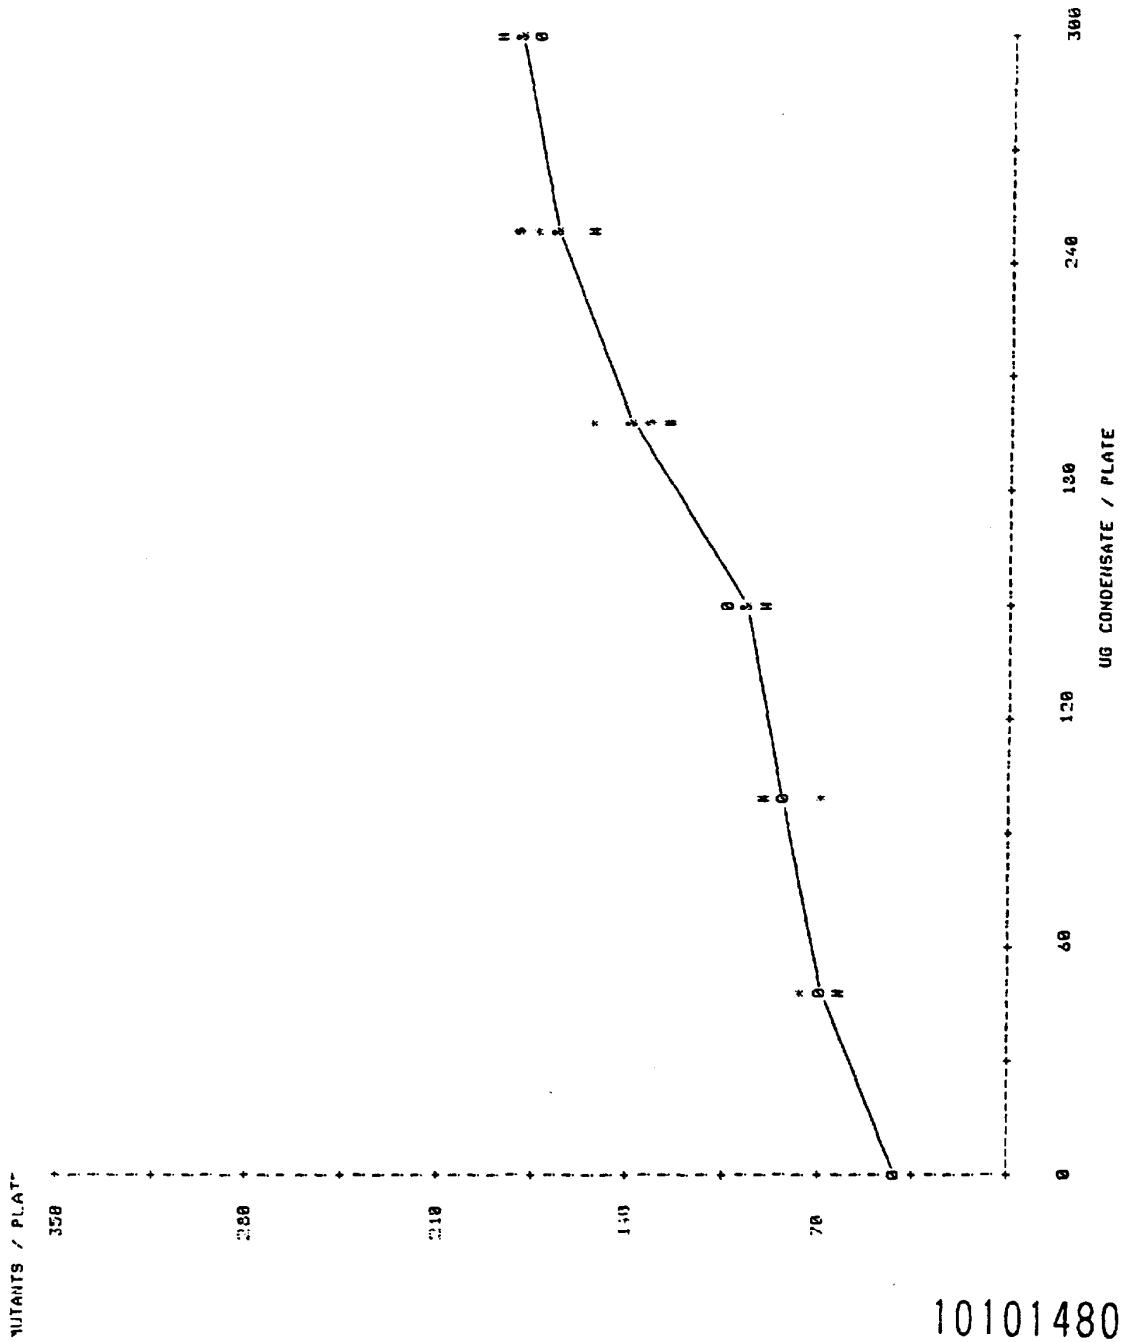

KEY: ←-PLATE1 \$-PLATE2 H-PLATE3 H-MEAN \$-MEAN FILENAME-B-26MATHIN-3

101014803