


EXPT 0-26

CIG SAMPLE NO MATI  
SMOKE TYPE R  
RUN NO -4  
SP DETAILS +AR13  
DATE 23/1/84  
FILENAME B-26MATIR-4

HIES TEST

DOSE UG.	COLONIES / PLATE			MEAN	CYTO. TOX.
	PLATE 1	PLATE 2	PLATE 3		
0	28.3	45	32.7	35.3 48.0	0
50	54	59	45	52.7 71.7	-
100	73	73.3	75.3	73.9 100.5	-
150	113.7	118.3	107.3	113.1 153.8	-
200	128	129.7	137.7	131.8 179.2	-
250	145	147.7	192.7	161.8 220.0	-
300	184.7	183.7	179	182.5 248.2	0

101014823

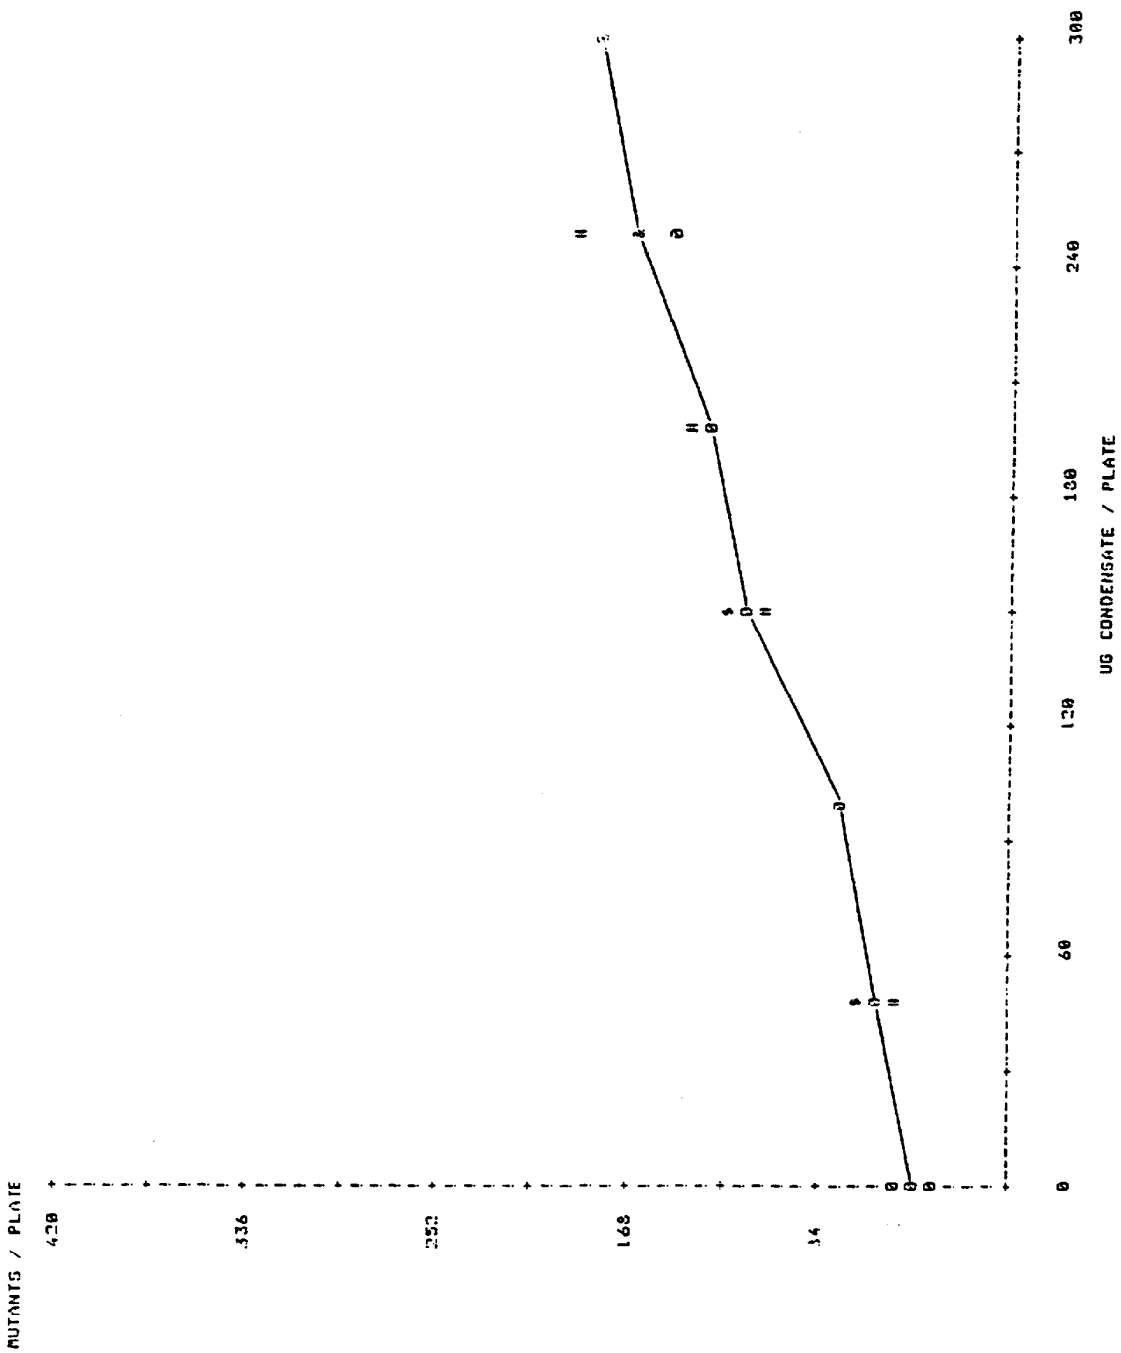

KEY: ---PLATE1 1-PLATE2 H-PLATE3 3-MEAN UG CONDENSATE / PLATE

101014824