

BATCO document for Province of British Columbia 16 April 1999


EXPT B-26

SMITH TEST
 =====

CIG SAMPLE NO PLAY
 SMOKE TYPE M
 RUN NO --4
 SP DETAILS +AR13
 DATE 23/1/84
 FILENAME B-26PLAYM-4

DOSE UG.	COLONIES / PLATE				MEAN	CYTO. TOX.
	PLATE 1	PLATE 2	PLATE 3			
0	41	50.7	45.3	45.7	62.2	0
50	52.3	71.7	59.7	61.2	83.2	-
100	105	87.3	97.7	96.7	131.6	-
150	100	132.7	107.3	114	155.04	-
200	138.7	163.3	167	156.3	212.6	-
250	168.3	202.3	176.7	182.4	248.1	-
300	185.7	185	181.3	184	250.2	0

101014827

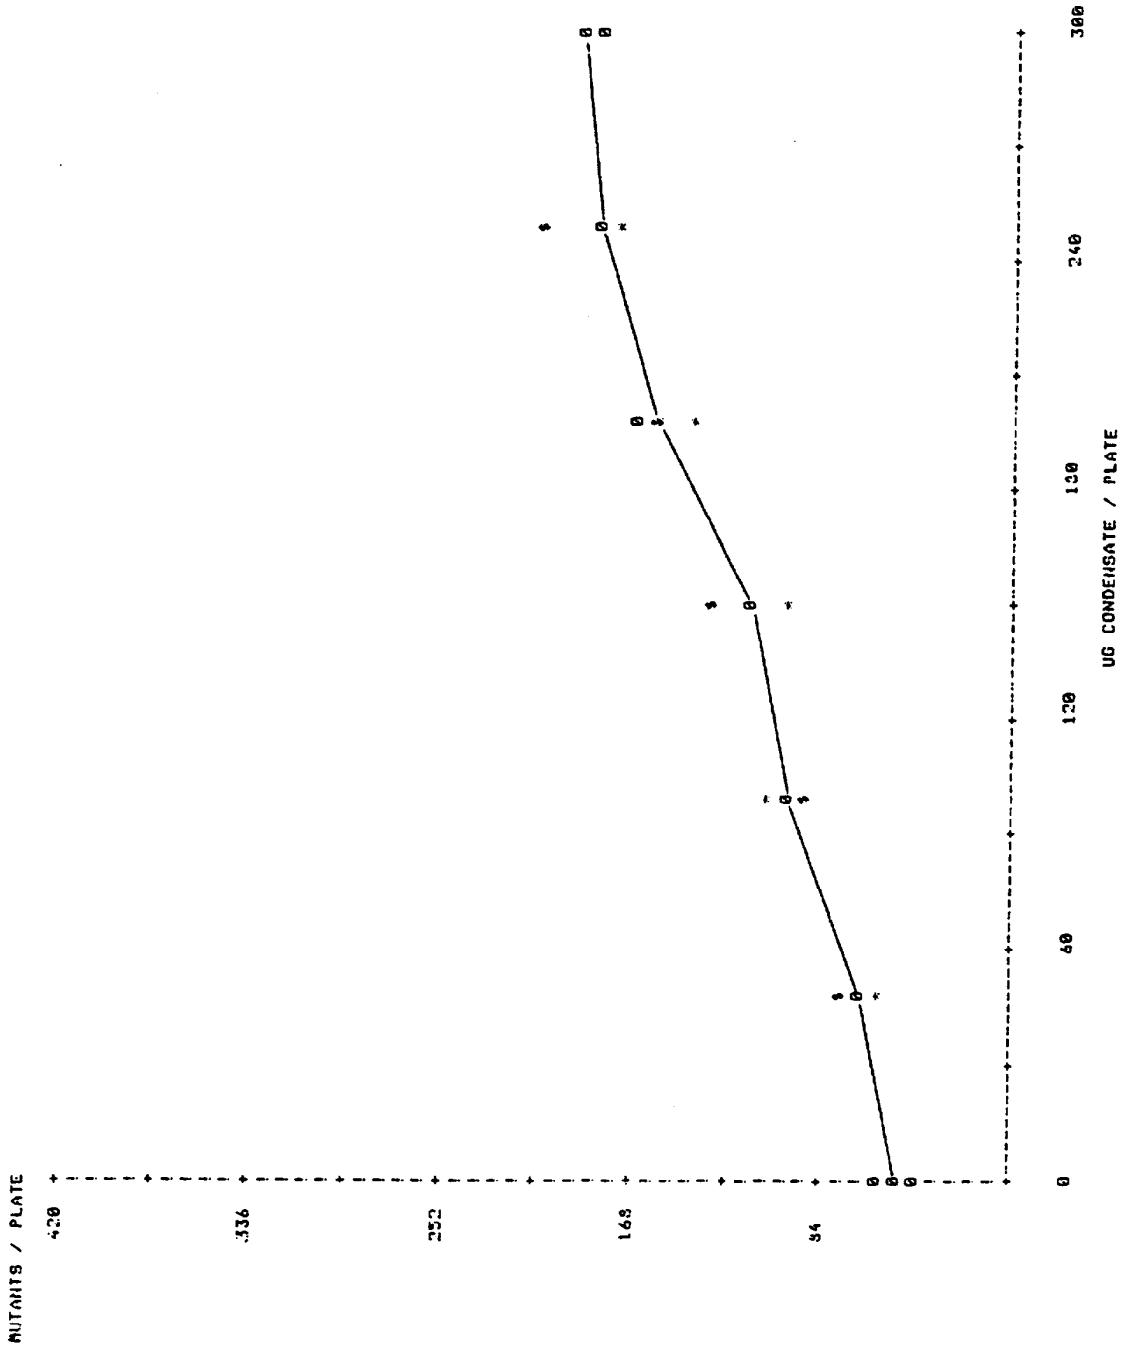

KEY: 1-PLATE1 2-PLATE2 3-PLATE3 4-PLATE4 5-MEAN 6-CONDENSATE / PLATE

101014828